


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, November 28, 2023**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Monday, November 27, 2023**

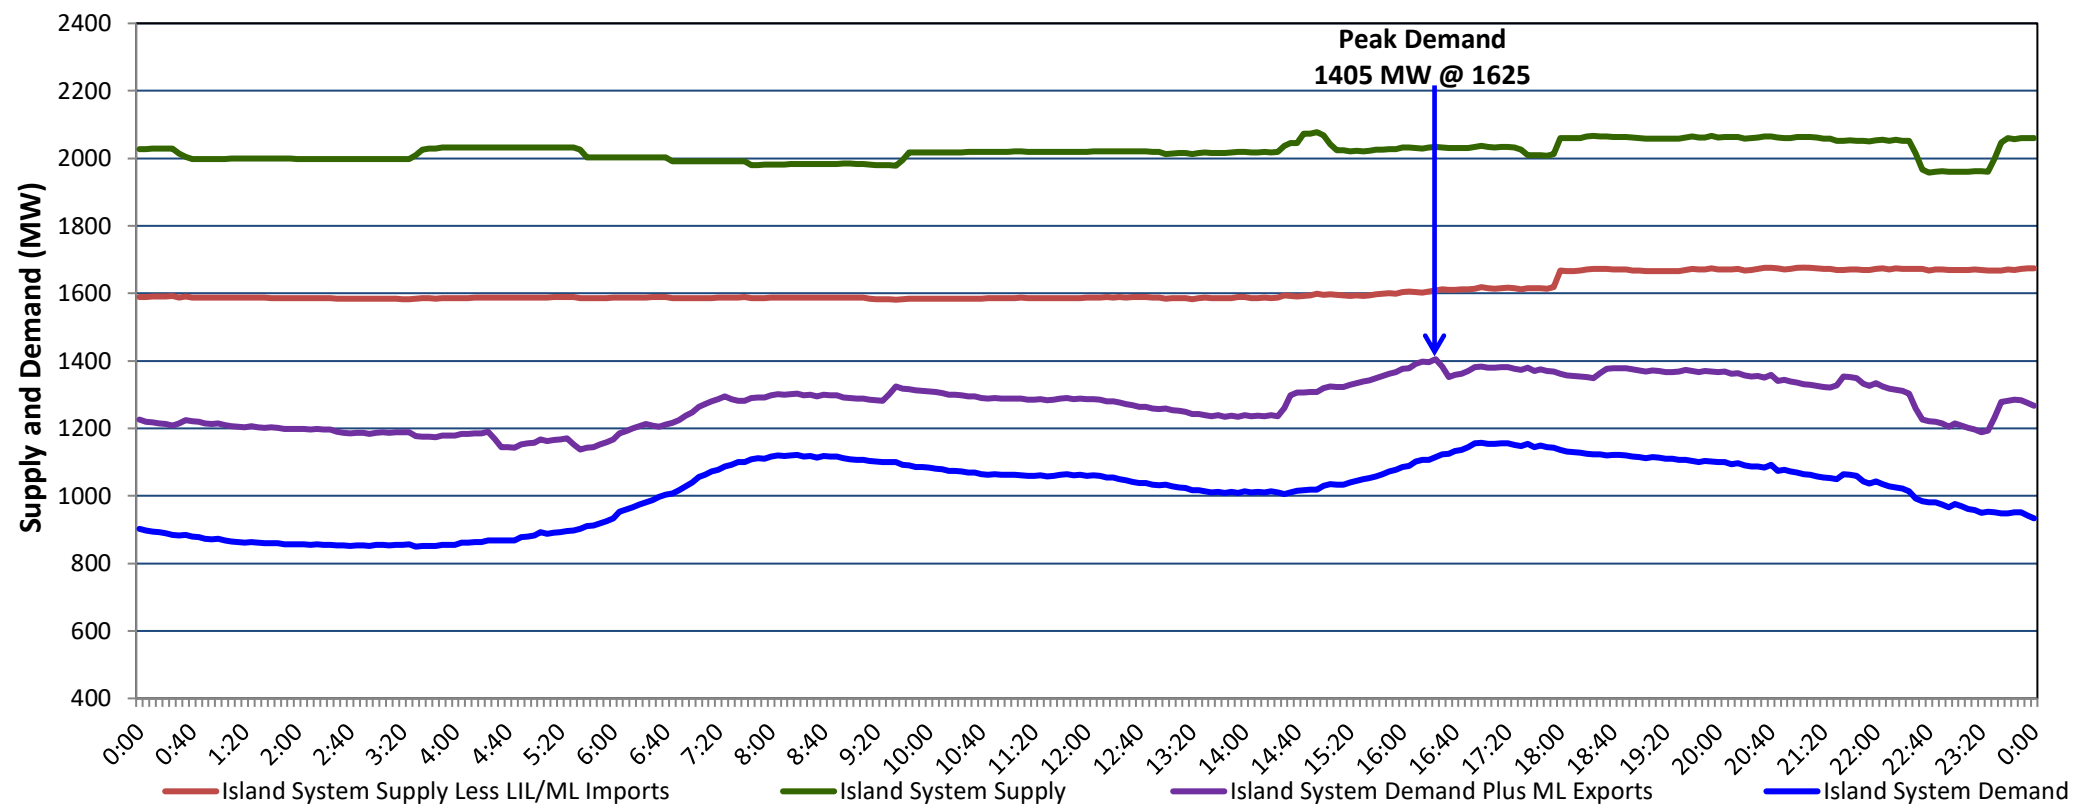

Supply Notes For November 27, 2023

- 1,2
- A As of 0701 hours, March 06, 2023, Upper Salmon Unit unavailable (84 MW).
 - B As of 0800 hours, May 21, 2023, Holyrood Unit 2 unavailable due to forced extension to planned outage (170 MW).
 - C As of 2059 hours, July 13, 2023, Stephenville Gas Turbine unavailable (50 MW).
 - D As of 1617 hours, November 17, 2023, Holyrood Unit 1 available at 140 MW (170 MW).
 - E At 1249 hours, November 27, 2023, St. Anthony Diesel Plant available at 7.7 MW (9.7 MW).
 - F At 1600 hours, November 27, 2023, St. Anthony Diesel Plant available at full capacity (9.7 MW).
 - G At 1755 hours, November 27, 2023, Holyrood Unit 3 available at 122 MW (150 MW).

**Section 2
Island Interconnected Supply and Demand**

Tue, Nov 28, 2023	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,967 MW	Tuesday, November 28, 2023	6	8	1,385	1,299
NLH Island Generation: ^{4,8}	1,330 MW	Wednesday, November 29, 2023	2	0	1,195	1,111
NLH Island Power Purchases: ⁶	130 MW	Thursday, November 30, 2023	-1	-3	1,280	1,195
Other Island Generation:	180 MW	Friday, December 1, 2023	-1	3	1,265	1,180
ML/LIL Imports:	327 MW	Saturday, December 2, 2023	3	2	1,170	1,086
Current St. John's Temperature & Windchill:	5 °C	Sunday, December 3, 2023	0	-3	1,375	1,289
7-Day Island Peak Demand Forecast:	1,385 MW	Monday, December 4, 2023	-4	-3	1,375	1,289

Supply Notes For November 28, 2023

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Nov 27, 2023	Actual Island Peak Demand ⁹	16:25	1,405 MW
Tue, Nov 28, 2023	Forecast Island Peak Demand		1,385 MW

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).