
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Wednesday, March 20, 2024

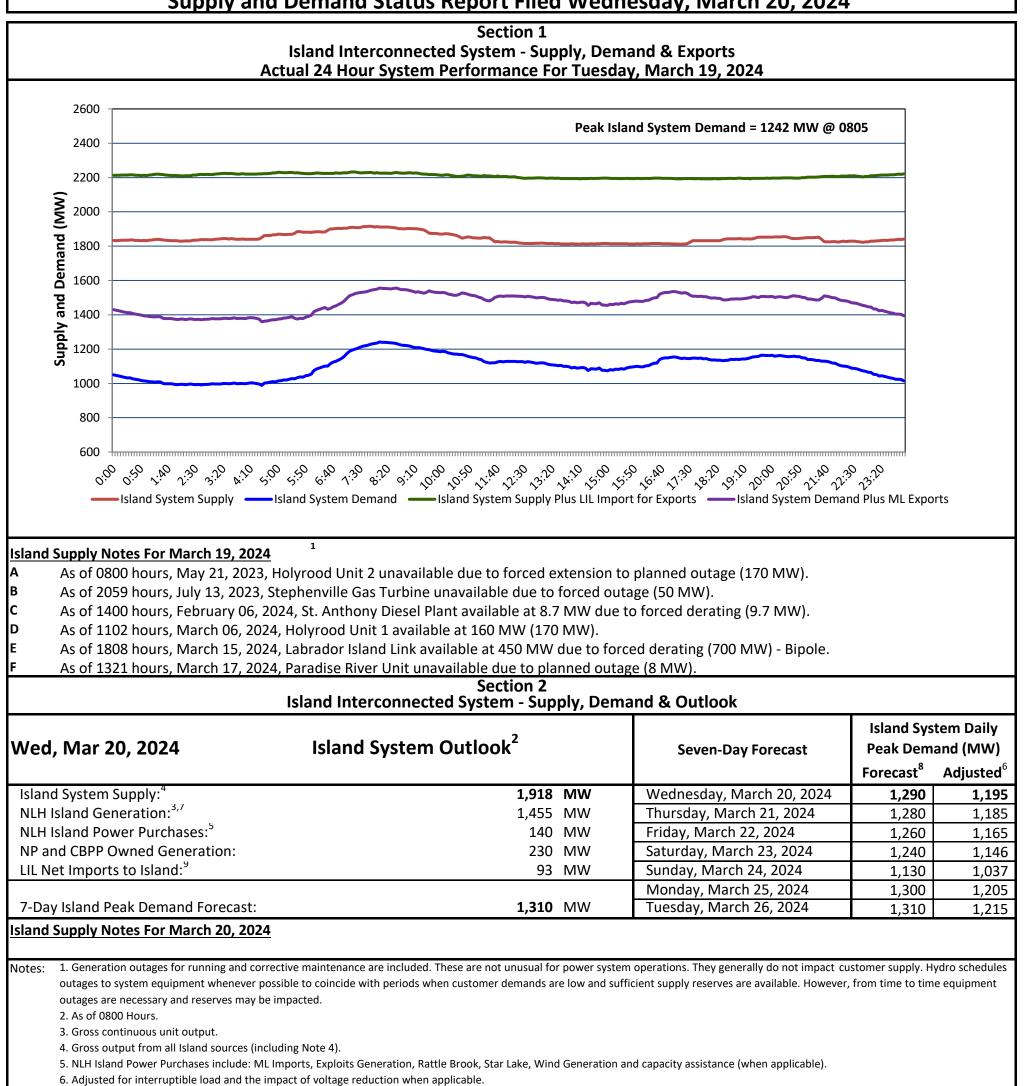

7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

8. Does not include ML Exports.

9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Island Peak Demand and Exports Information Previous Day Actual Peak and Current Day Forecast Peak			
Гие, Mar 19, 2024	Island Peak Demand ¹⁰	8:05	1,242 MW
	Exports at Peak		314 MW
	LIL Net Imports to Island		1,670 MWh
Ved, Mar 20, 2024	Forecast Island Peak Demand		1,290 MW