
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, April 26, 2024

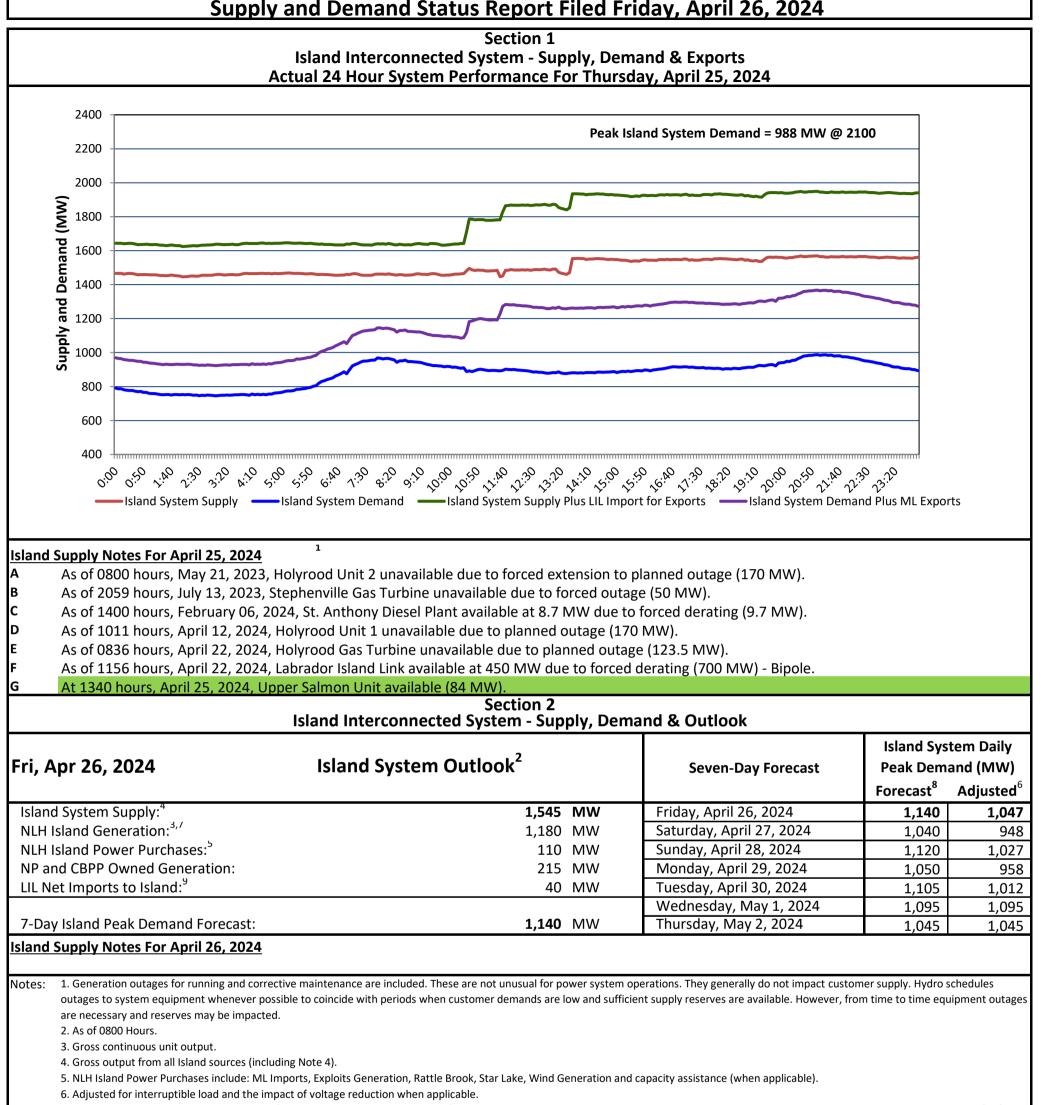

7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

8. Does not include ML Exports.

9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3 Island Peak Demand and Exports Information Previous Day Actual Peak and Current Day Forecast Peak			
Thu, Apr 25, 2024	Island Peak Demand ¹⁰	21:00	988 MW
	Exports at Peak		380 MW
	LIL Net Imports to Island		766 MWh
Fri, Apr 26, 2024	Forecast Island Peak Demand		1,140 MW
Notes: 10. Island Demand is supplie Lake Power, DLP).	ed by NLH generation and purchases, LIL Imports plus generation owned ar	nd operated by Newfoundland Power and	Corner Brook Pulp & Paper (Dee