


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, July 28, 2025

Section 1
Island Interconnected System - Supply, Demand & Exports
Actual 24 Hour System Performance For Friday, July 25, 2025

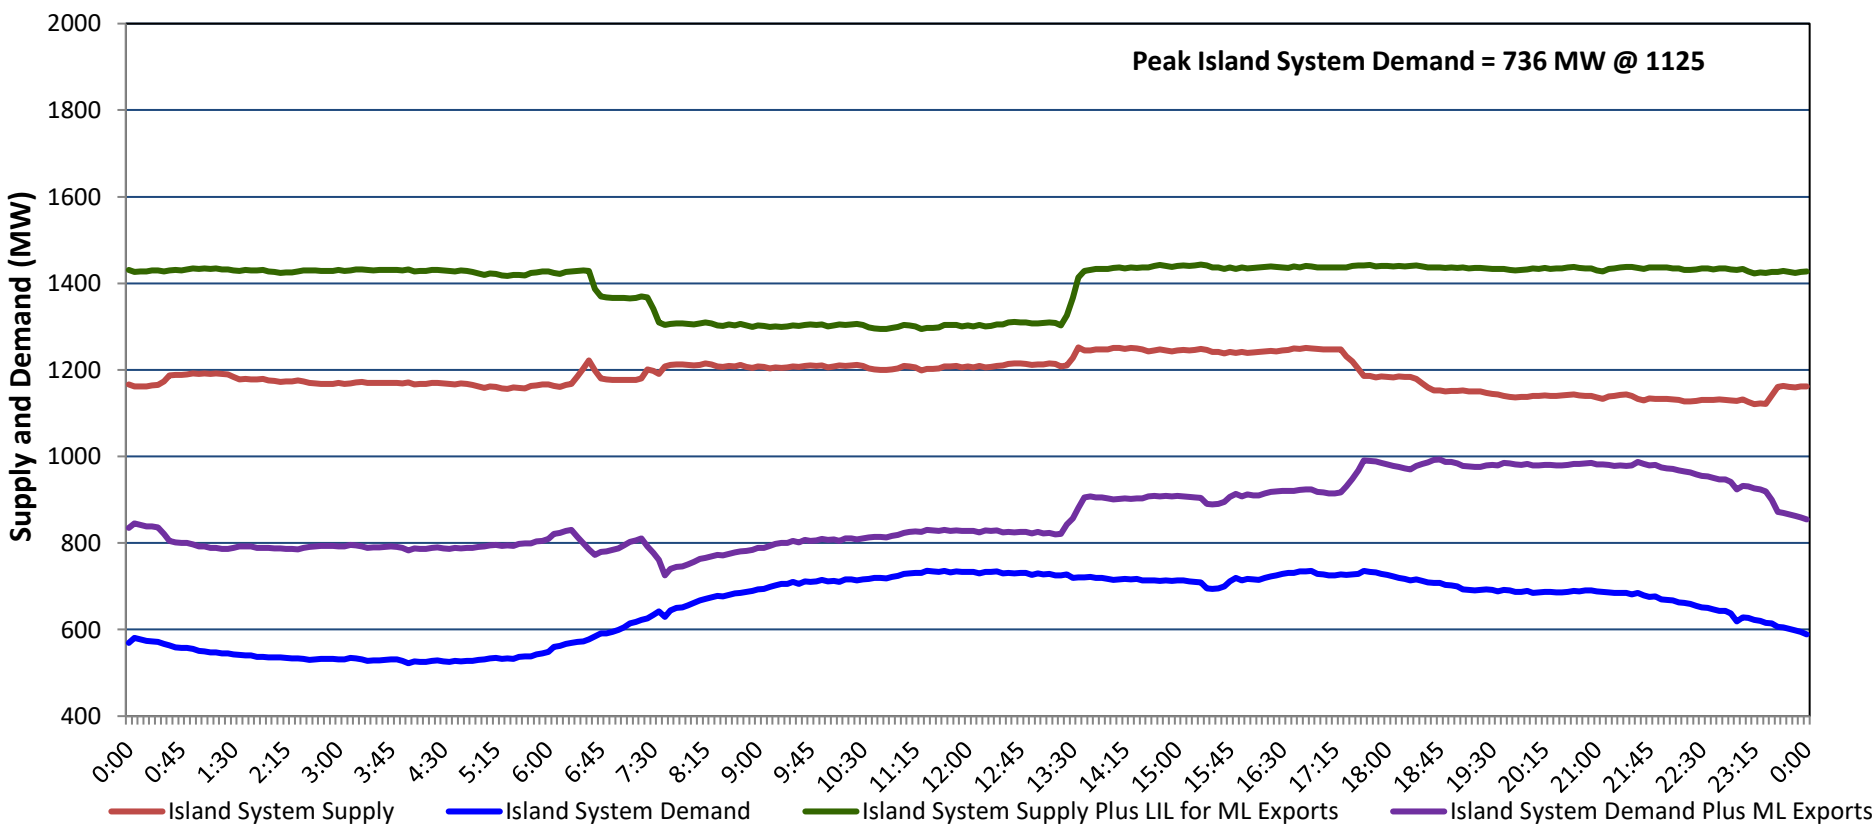

Island Supply Notes For July 25, 2025

- A As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).
B As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
C As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
D As of 0800 hours, May 04, 2025, Holyrood Unit 1 unavailable due to planned outage (170 MW).
E As of 0851 hours, May 05, 2025, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).
F As of 0800 hours, June 08, 2025, Holyrood Unit 2 unavailable due to planned outage 115 MW (170 MW).
G As of 1336 hours, June 15, 2025, Granite Canal Unit unavailable due to planned outage (40 MW).
H As of 1400 hours, June 29, 2025, St. Anthony Diesel Plant available at 7.7 MW due to forced derating (9.7 MW).
I As of 0926 hours, July 21, 2025, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
J As of 0549 hours, July 24, 2025, Cat Arm Unit 1 unavailable due to planned outage (67 MW).

Section 2
Island Interconnected System - Supply, Demand & Outlook

Sat, Jul 26, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴	1,197 MW	Saturday, July 26, 2025	740	690
NLH Island Generation: ^{3,7}	825 MW	Sunday, July 27, 2025	695	645
NLH Island Power Purchases: ⁵	100 MW	Monday, July 28, 2025	775	725
NP and CBPP Owned Generation:	190 MW	Tuesday, July 29, 2025	765	715
LIL/ML Net Imports to Island: ⁹	82 MW	Wednesday, July 30, 2025	780	730
7-Day Island Peak Demand Forecast:	780 MW	Thursday, July 31, 2025	780	730
		Friday, August 1, 2025	745	695

Island Supply Notes For July 26, 2025

- K At 0000 hours, July 26, 2025, Granite Canal Unit unavailable due to forced extension to planned outage (40 MW).
- Notes: 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
2. As of 0800 Hours.
3. Gross continuous unit output.
4. Gross output from all Island sources (including Note 3).
5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
6. Adjusted for interruptible load and the impact of voltage reduction when applicable.
7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.
8. Does not include ML Exports.
9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3
Island Peak Demand and Exports Information
Previous Day Actual Peak and Current Day Forecast Peak

Fri, Jul 25, 2025	Island Peak Demand ¹⁰	11:25	736 MW
	Exports at Peak		95 MW
	LIL Net Imports to Island		1,397 MWh
Sat, Jul 26, 2025	Forecast Island Peak Demand		740 MW

- Notes: 10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).