


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, June 02, 2026**

**Section 1  
Island Interconnected System - Supply, Demand & Exports  
Actual 24 Hour System Performance For Monday, June 01, 2026**

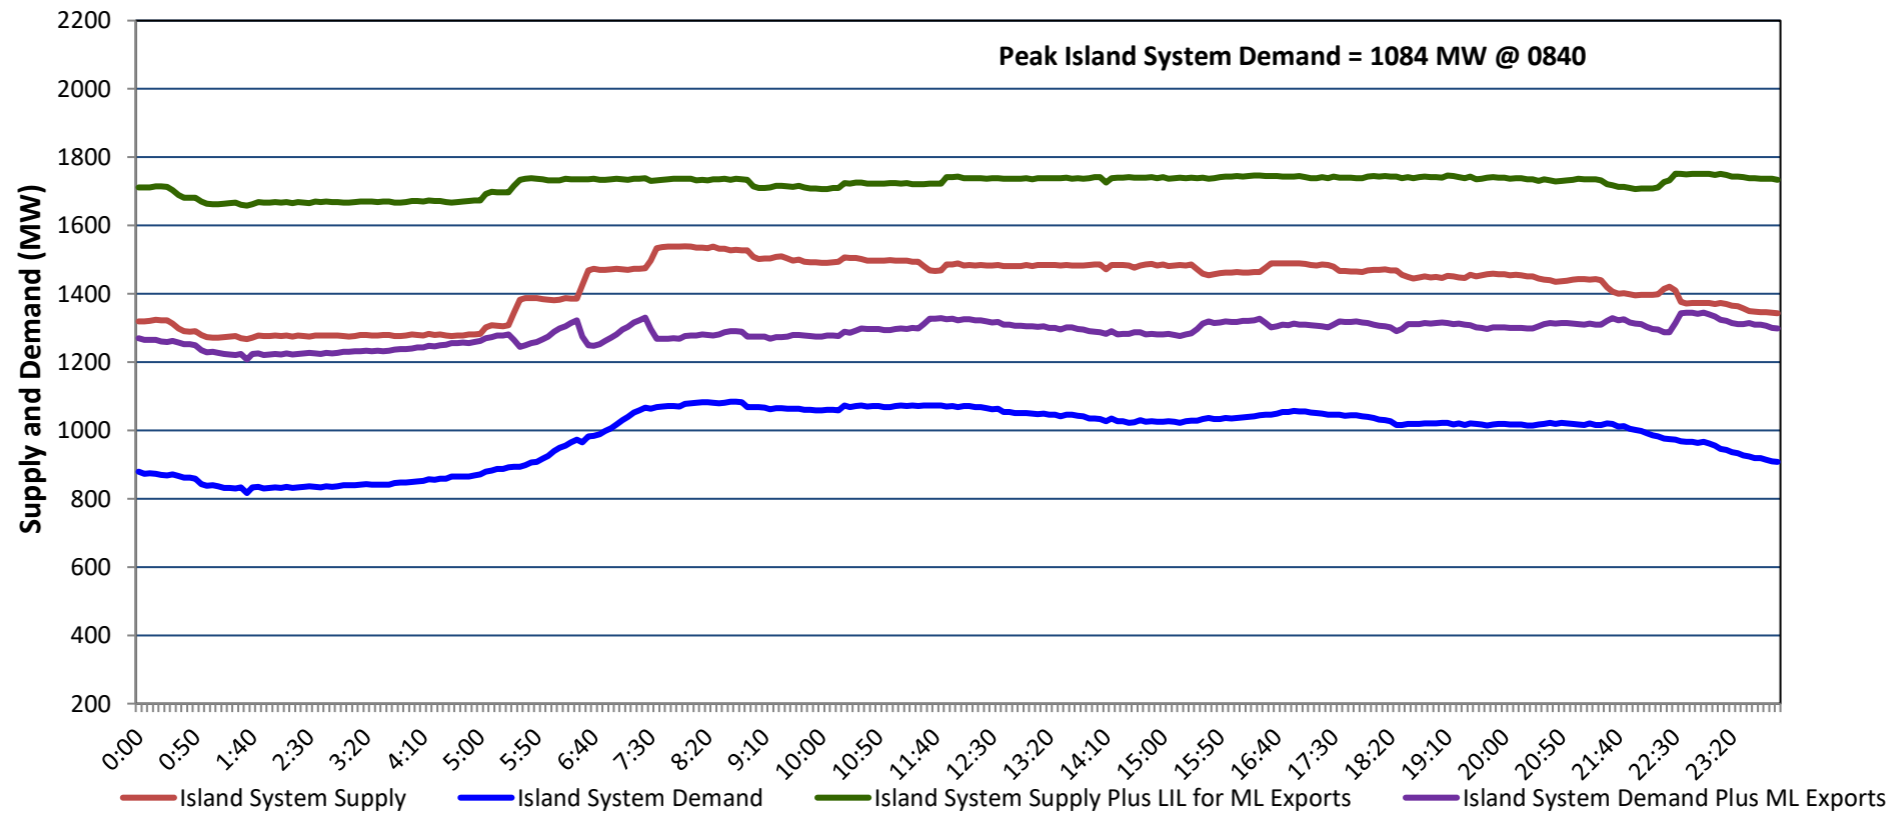

**Island Supply Notes For June 01, 2026**

- A As of 1326 hours, February 05, 2026, Cat Arm Unit 2 available at 57 MW due to forced derating (67 MW).
- B As of 0800 hours, March 29, 2026, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- C As of 1513 hours, April 16, 2026, St. Anthony Diesel Plant available at 7.7 MW due to forced derating (9.7 MW).
- D As of 0800 hours, May 06, 2026, Holyrood Unit 2 unavailable due to planned outage 40 MW (170 MW).
- E As of 1052 hours, May 06, 2026, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
- F As of 1052 hours, May 06, 2026, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
- G As of 0701 hours, May 24, 2026, Holyrood Unit 1 unavailable due to planned outage 166 MW (170 MW).
- H As of 0841 hours, May 24, 2026, Hinds Lake Unit unavailable due to planned outage (75 MW).
- I As of 1241 hours, May 27, 2026, Stephenville Gas Turbine available at 25 MW due to forced derating (50 MW).

**Section 2  
Island Interconnected System - Supply, Demand & Outlook**

Tue, Jun 02, 2026	Island System Outlook <sup>2</sup>	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast <sup>8</sup>	Adjusted <sup>6</sup>
Island System Supply: <sup>4</sup>	1,504 MW	Tuesday, June 2, 2026	1,075	1,025
NLH Island Generation: <sup>3,7</sup>	940 MW	Wednesday, June 3, 2026	975	925
NLH Island Power Purchases: <sup>5</sup>	80 MW	Thursday, June 4, 2026	850	800
NP and CBPP Owned Generation:	220 MW	Friday, June 5, 2026	805	755
LIL/ML Net Imports to Island: <sup>9</sup>	264 MW	Saturday, June 6, 2026	925	875
		Sunday, June 7, 2026	875	825
7-Day Island Peak Demand Forecast:	1,075 MW	Monday, June 8, 2026	925	875

**Island Supply Notes For June 02, 2026**

- Notes:
- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - 2. As of 0800 Hours.
  - 3. Gross continuous unit output.
  - 4. Gross output from all Island sources (including Note 3).
  - 5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  - 6. Adjusted for interruptible load and the impact of voltage reduction when applicable.
  - 7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.
  - 8. Does not include ML Exports.
  - 9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

**Section 3  
Island Peak Demand and Exports Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Jun 01, 2026	Island Peak Demand <sup>10</sup>	8:40	1,084 MW
	Exports at Peak		207 MW
	LIL Net Imports to Island		4,629 MWh
Tue, Jun 02, 2026	Forecast Island Peak Demand		1,075 MW

- Notes: 10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).