


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, June 30, 2026

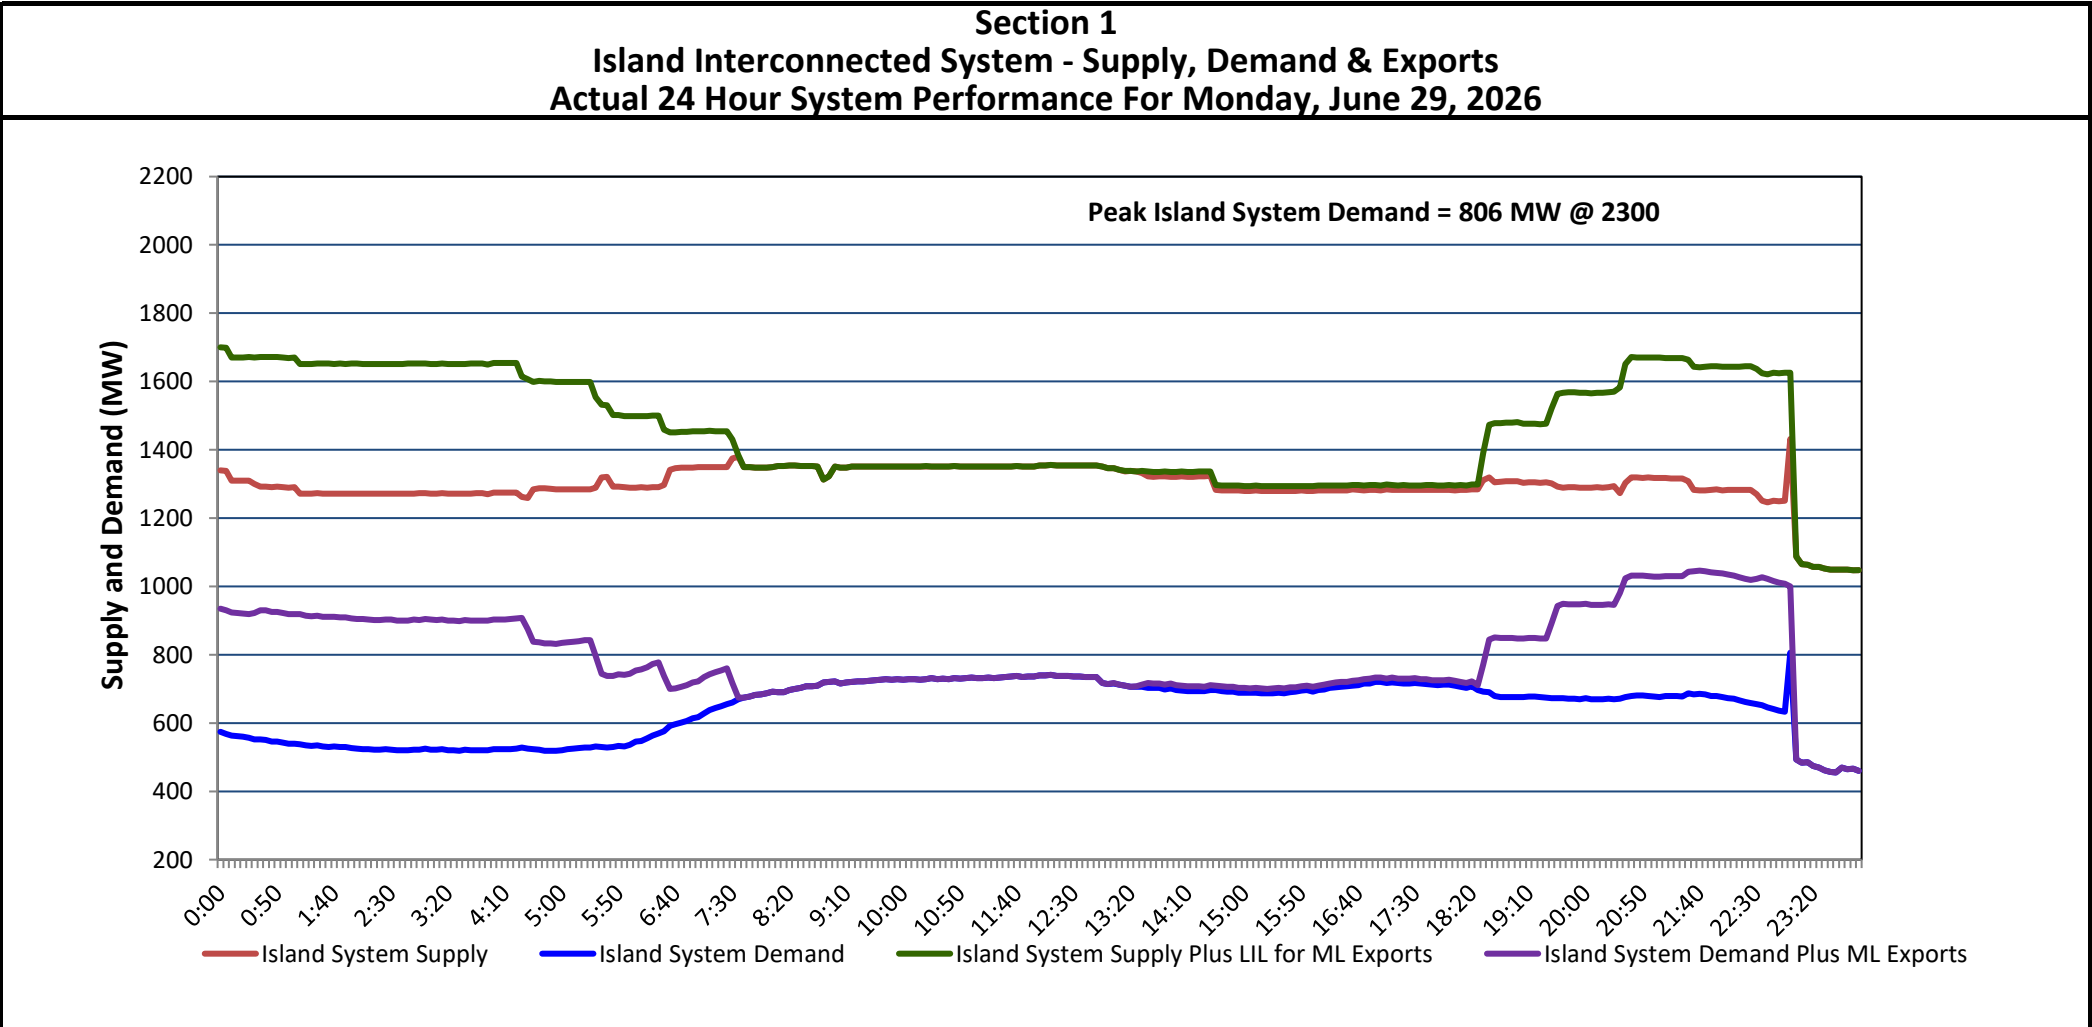

1

Island Supply Notes For June 29, 2026	
A	As of 0800 hours, March 29, 2026, Holyrood Unit 3 unavailable due to planned outage (150 MW).
B	As of 1513 hours, April 16, 2026, St. Anthony Diesel Plant available at 7.7 MW due to forced derating (9.7 MW).
C	As of 0800 hours, May 06, 2026, Holyrood Unit 2 unavailable due to planned outage 40 MW (170 MW).
D	As of 0701 hours, May 24, 2026, Holyrood Unit 1 unavailable due to planned outage 166 MW (170 MW).
E	As of 0841 hours, May 24, 2026, Hinds Lake Unit unavailable due to planned outage (75 MW).
F	As of 0834 hours, June 15, 2026, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
G	As of 0834 hours, June 15, 2026, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
H	At 0848 hours, June 29, 2026, Labrador Island Link unavailable due to planned testing (900 MW).
I	At 1433 hours, June 29, 2026, Granite Canal Unit unavailable due to planned outage (40 MW).
J	At 1815 hours, June 29, 2026, Labrador Island Link available (900 MW).
K	At 2304 hours, June 29, 2026, Cat Arm Unit 1 unavailable due to forced outage (67 MW).
L	At 2304 hours, June 29, 2026, Cat Arm Unit 2 unavailable due to forced outage 57 MW (67 MW).
M	At 2304 hours, June 29, 2026, Stephenville Gas Turbine unavailable due to forced outage (50 MW).

Section 2 Island Interconnected System - Supply, Demand & Outlook						
Tue, Jun 30, 2026	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)			
			Forecast ⁸	Adjusted ⁶		
		Island System Supply: ⁴	1,284 MW	Tuesday, June 30, 2026	760	725
		NLH Island Generation: ^{3,7}	925 MW	Wednesday, July 1, 2026	745	710
		NLH Island Power Purchases: ⁵	75 MW	Thursday, July 2, 2026	765	730
		NP and CBPP Owned Generation:	200 MW	Friday, July 3, 2026	770	735
		LIL Net Imports to Island: ⁹	84 MW	Saturday, July 4, 2026	750	700
				Sunday, July 5, 2026	765	715
7-Day Island Peak Demand Forecast:	790 MW	Monday, July 6, 2026	790	740		

Island Supply Notes For June 30, 2026	
N	At 0239 hours, June 30, 2026, Cat Arm Unit 2 available at 57 MW due to forced derating (67 MW).
O	At 0243 hours, June 30, 2026, Cat Arm Unit 1 available (67 MW).
P	At 0317 hours, June 30, 2026, Stephenville Gas Turbine available (50 MW).
Notes:	1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted. 2. As of 0800 Hours. 3. Gross continuous unit output. 4. Gross output from all Island sources (including Note 3). 5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable). 6. Adjusted for interruptible load and the impact of voltage reduction when applicable. 7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine. 8. Does not include ML Exports. 9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3 Island Peak Demand and Exports Information Previous Day Actual Peak and Current Day Forecast Peak			
Mon, Jun 29, 2026	Island Peak Demand ¹⁰	23:00	806 MW
	Exports at Peak		194 MW
	LIL Net Imports to Island		1,793 MWh
Tue, Jun 30, 2026	Forecast Island Peak Demand		760 MW
Notes:	10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).		