
Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, November 16, 2026

Section 1
Island Interconnected System - Supply, Demand & Exports
Actual 24 Hour System Performance For Sunday, November 15, 2026

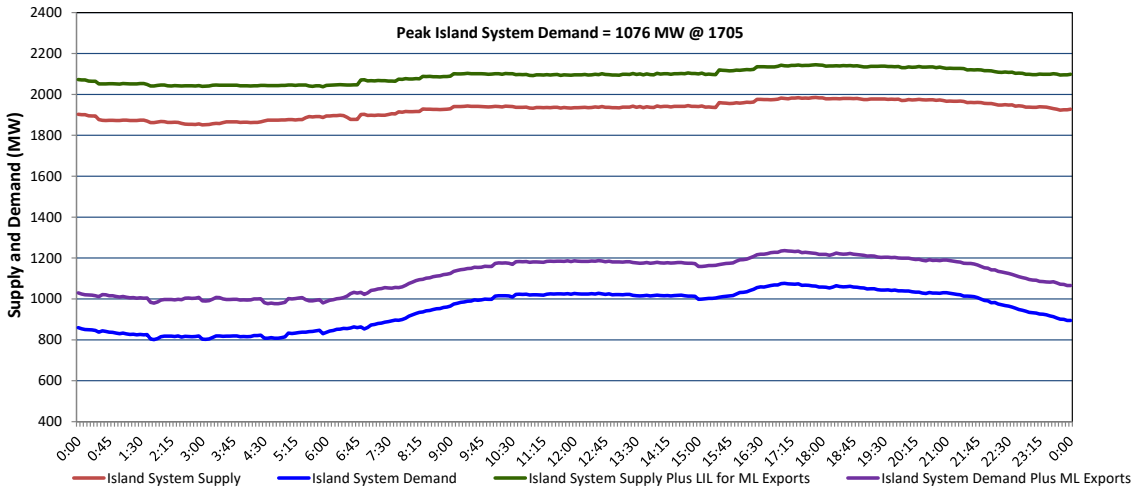

Island Supply Notes For November 15, 2026 [1]

A As of 0800 hours, May 06, 2026, Holyrood Unit 2 unavailable due to planned outage 40 MW (170 MW).
B As of 1348 hours, October 23, 2026, St. Anthony Diesel Plant available at 6.7 MW due to forced derating (9.7 MW).
C As of 1700 hours, October 23, 2026, Hinds Lake Unit unavailable due to forced extension to planned outage (75 MW).
D As of 1345 hours, November 09, 2026, Holyrood Unit 3 unavailable due to planned outage (150 MW).

Section 2
Island Interconnected System - Supply, Demand & Outlook

Mon, Nov 16, 2026	Island System Outlook[2]		Seven-Day Forecast	Island System Daily Peak Demand (MW)	
				Forecast[8]	Adjusted[6]
Island System Supply:[4]	**1,980**	**MW**	Monday, November 16, 2026	**1,205**	**1,121**
NLH Island Generation:[3,7,10]	1,295	MW	Tuesday, November 17, 2026	1,230	1,146
NLH Island Power Purchases:[5]	95	MW	Wednesday, November 18, 2026	1,155	1,072
NP and CBPP Owned Generation:	195	MW	Thursday, November 19, 2026	1,180	1,096
LIL Net Imports to Island:[9]	395	MW	Friday, November 20, 2026	1,130	1,047
			Saturday, November 21, 2026	1,235	1,151
7-Day Island Peak Demand Forecast:	**1,235**	MW	Sunday, November 22, 2026	1,185	1,101

Island Supply Notes For November 16, 2026

Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
2. As of 0800 Hours.
3. Gross continuous unit output.
4. Gross output from all Island sources (including Note 3).
5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
6. Adjusted for interruptible load and the impact of voltage reduction when applicable.
7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.
8. Does not include ML Exports.
9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.
10. Run-of-river hydro resources are subject to hydrological variability. Reported firm capacity reflects the capacity expected to be available during peak demand periods.

Section 3
Island Peak Demand and Exports Information
Previous Day Actual Peak and Current Day Forecast Peak

Sun, Nov 15, 2026	Island Peak Demand[11]	17:05	1,076	MW
	Exports at Peak		160	MW
	LIL Net Imports to Island		8,318	MWh
Mon, Nov 16, 2026	Forecast Island Peak Demand		1,205	MW

Notes: 11. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).