


- 1 **Q. Provide Newfoundland Power’s generator preventive maintenance backlogs and its**  
 2 **corrective maintenance backlogs at the end of 2010, 2011, 2012, 2013 and 2014.**  
 3  
 4 A. Newfoundland Power’s generation preventative and corrective maintenance practices are  
 5 described in response to Request for Information PUB-NP-175. The following tables and  
 6 charts show the completed and backlogged work at the end of years 2010, 2011, 2012,  
 7 2013 and 2014 YTD.  
 8  
 9

**Table 1**  
**Preventative Maintenance Work Orders**

	<b>2010</b>	<b>2011</b>	<b>2012</b>	<b>2013</b>	<b>2014 (YTD)</b>
Completed	1,945	1,995	1,922	1,880	975
Backlogged <sup>1</sup>	157	229	280	312	282 <sup>2</sup>
% Complete	92.5%	89.7%	87.3%	85.8%	77.6%

**Chart 1**  
**Preventative Maintenance**

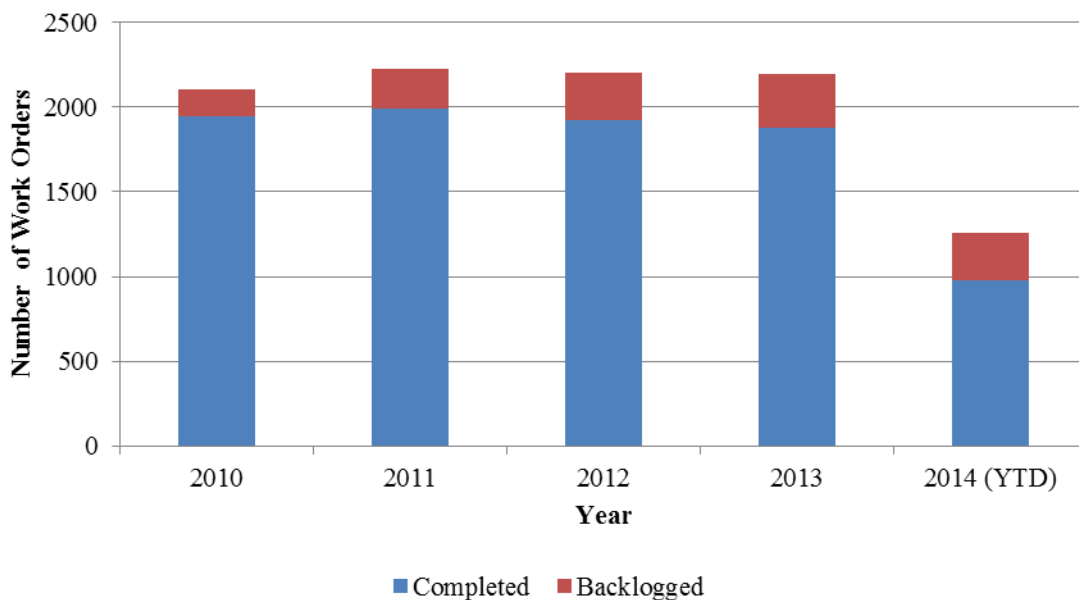


<sup>1</sup> Backlogged preventative maintenance work orders were either completed or rescheduled in the following year.

<sup>2</sup> The 282 preventative maintenance work orders identified as backlogged for 2014 are actually the scheduled work orders to be completed during the remainder of 2014. Newfoundland Power is not currently forecasting any backlogged preventative maintenance work orders for yearend 2014.

**Table 2**  
**Corrective Maintenance Work Orders**

	2010	2011	2012	2013	2014 (YTD)
Completed	120	90	83	73	55
Backlogged <sup>3</sup>	5	3	4	7	26 <sup>4</sup>
% Complete	96.0%	96.8%	95.4%	91.3%	67.9%

**Chart 2**  
**Corrective Maintenance**

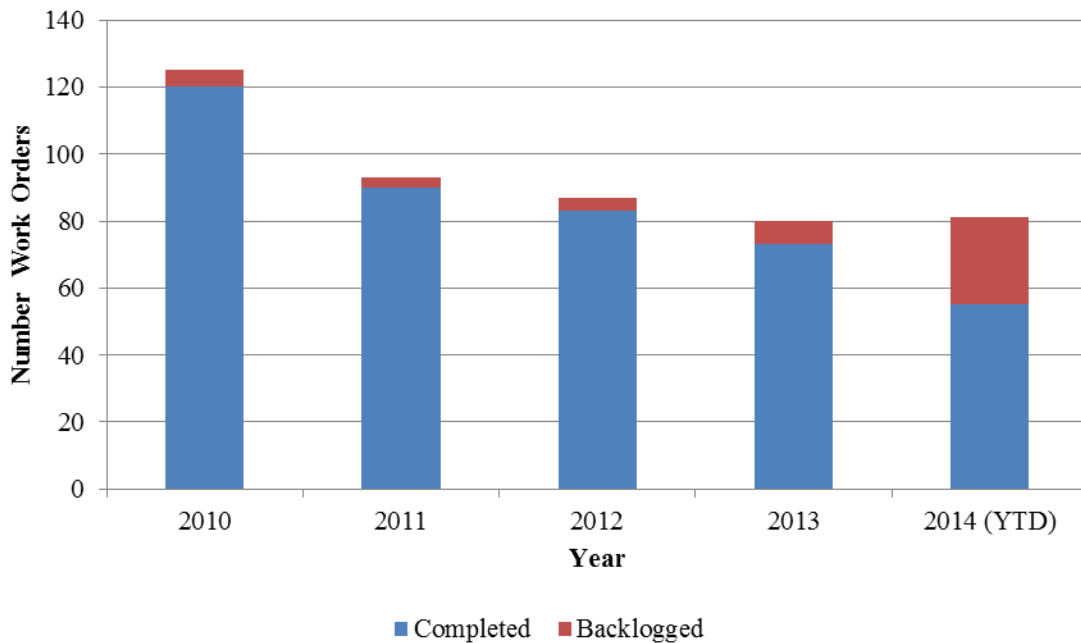

<sup>3</sup> All corrective maintenance work orders were completed in the following year.

<sup>4</sup> The 26 corrective maintenance work orders identified as backlogged for 2014 are actually the scheduled work orders to be completed during the remainder of 2014. Newfoundland Power is not currently forecasting any backlogged corrective maintenance work orders for yearend 2014.