


Q. Provide a table comparing Newfoundland Power's SAIDI and SAIFI values with the Canadian Electricity Association (CEA) average values for each year from 1998 to 2013.

A. Table 1 below details both Newfoundland Power's SAIDI and SAIFI values and the Canadian Electricity Association (CEA) average values for each year from 1998 to 2013. Data excludes significant events and loss of supply.

**Table 1
Reliability Data
1998 - 2013**

	SAIDI		SAIFI	
	<u>NP</u>	<u>CEA</u>	<u>NP</u>	<u>CEA</u>
1998	4.91	7.70	3.21	2.07
1999	5.70	4.44	4.72	2.09
2000	5.32	3.36	4.11	2.47
2001	3.42	3.85	2.99	2.68
2002	4.18	4.26	3.25	2.56
2003	4.11	2.73	3.00	2.02
2004	4.56	4.67	3.10	2.30
2005	3.27	5.86	2.57	2.46
2006	2.89	5.21	2.65	2.54
2007	2.65	5.94	2.11	2.13
2008	2.67	5.28	2.35	2.18
2009	2.57	4.60	1.99	2.31
2010	2.59	5.17	1.52	1.96
2011	2.57	5.50	1.70	2.34
2012	2.44	4.71	1.72	2.03
2013	2.23	9.02	1.71	2.19

- 1 SAIDI for NP and CEA for the period 1998 – 2013 is shown graphically below:

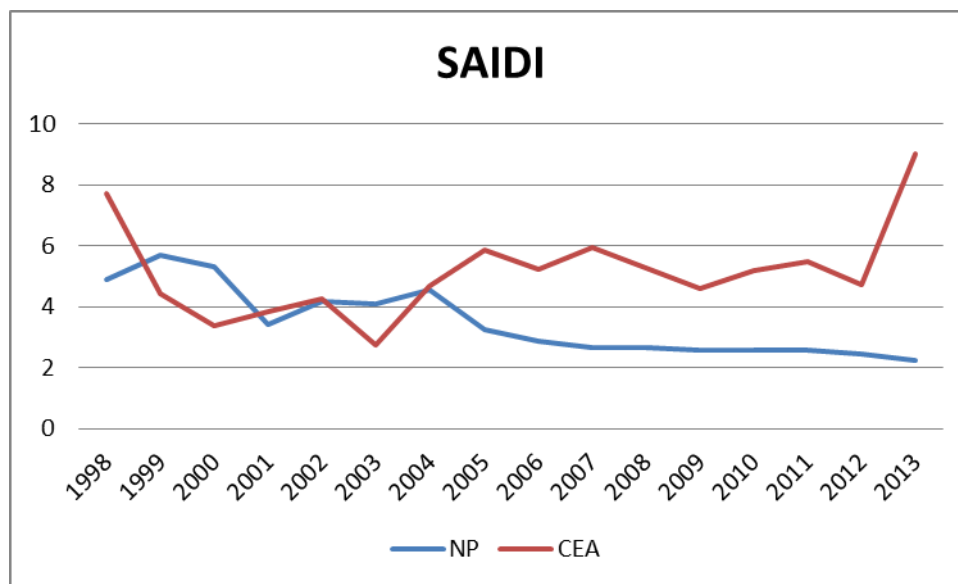

- 2 SAIFI for NP and CEA for the period 1998 – 2013 is shown graphically below:

