

1 Q. Reference: Schedule 1 – Long-Term Supply for Southern Labrador – Phase 1

2 Please provide a technical depiction illustrating a typical structure built to a 66 kV standard but
3 operated at 25 kV and highlight the differences as compared to a typical 25 kV structure.

4

5

6 A. Figure 1 provides a technical depiction of a typical 25 kV structure. The proposed structure will
7 be of a similar design, using 66 kV pole standards. Please refer to Newfoundland and Labrador
8 Hydro's response to NP-NLH-032 for information regarding the differences proposed for the
9 system which will be built to a 66 kV standard but operated at 25 kV.

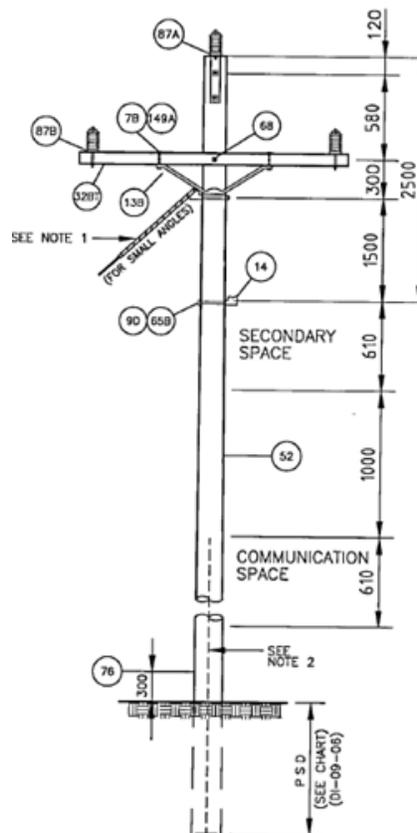


Figure 1: Typical 25 kV Structure